


F1	BLDG 5 & 6 - BASEMENT
1/16"=1'-0"	
CONSULTANTS:	
Reviews	
Date	
ARCHITECT / ENGINEERS: 3616 Masonic Drive Alexandria, LA 71301 Ph: 318.445.3151 Fx: 318.445.3988 Em: adg@adgllc.net	
Drawing Title FLOOR PLANS	Project Title SITE SECURITY PHASE I VETERAN AFFAIRS MEDICAL CENTER
Approved Project Director	Location ALEXANDRIA
Date 10.2018	Checked AUG
	Drawn AUG
Drawing Number A105	Building Number NA
Dwg 6 of 12	
Office of Construction and Facilities Management	

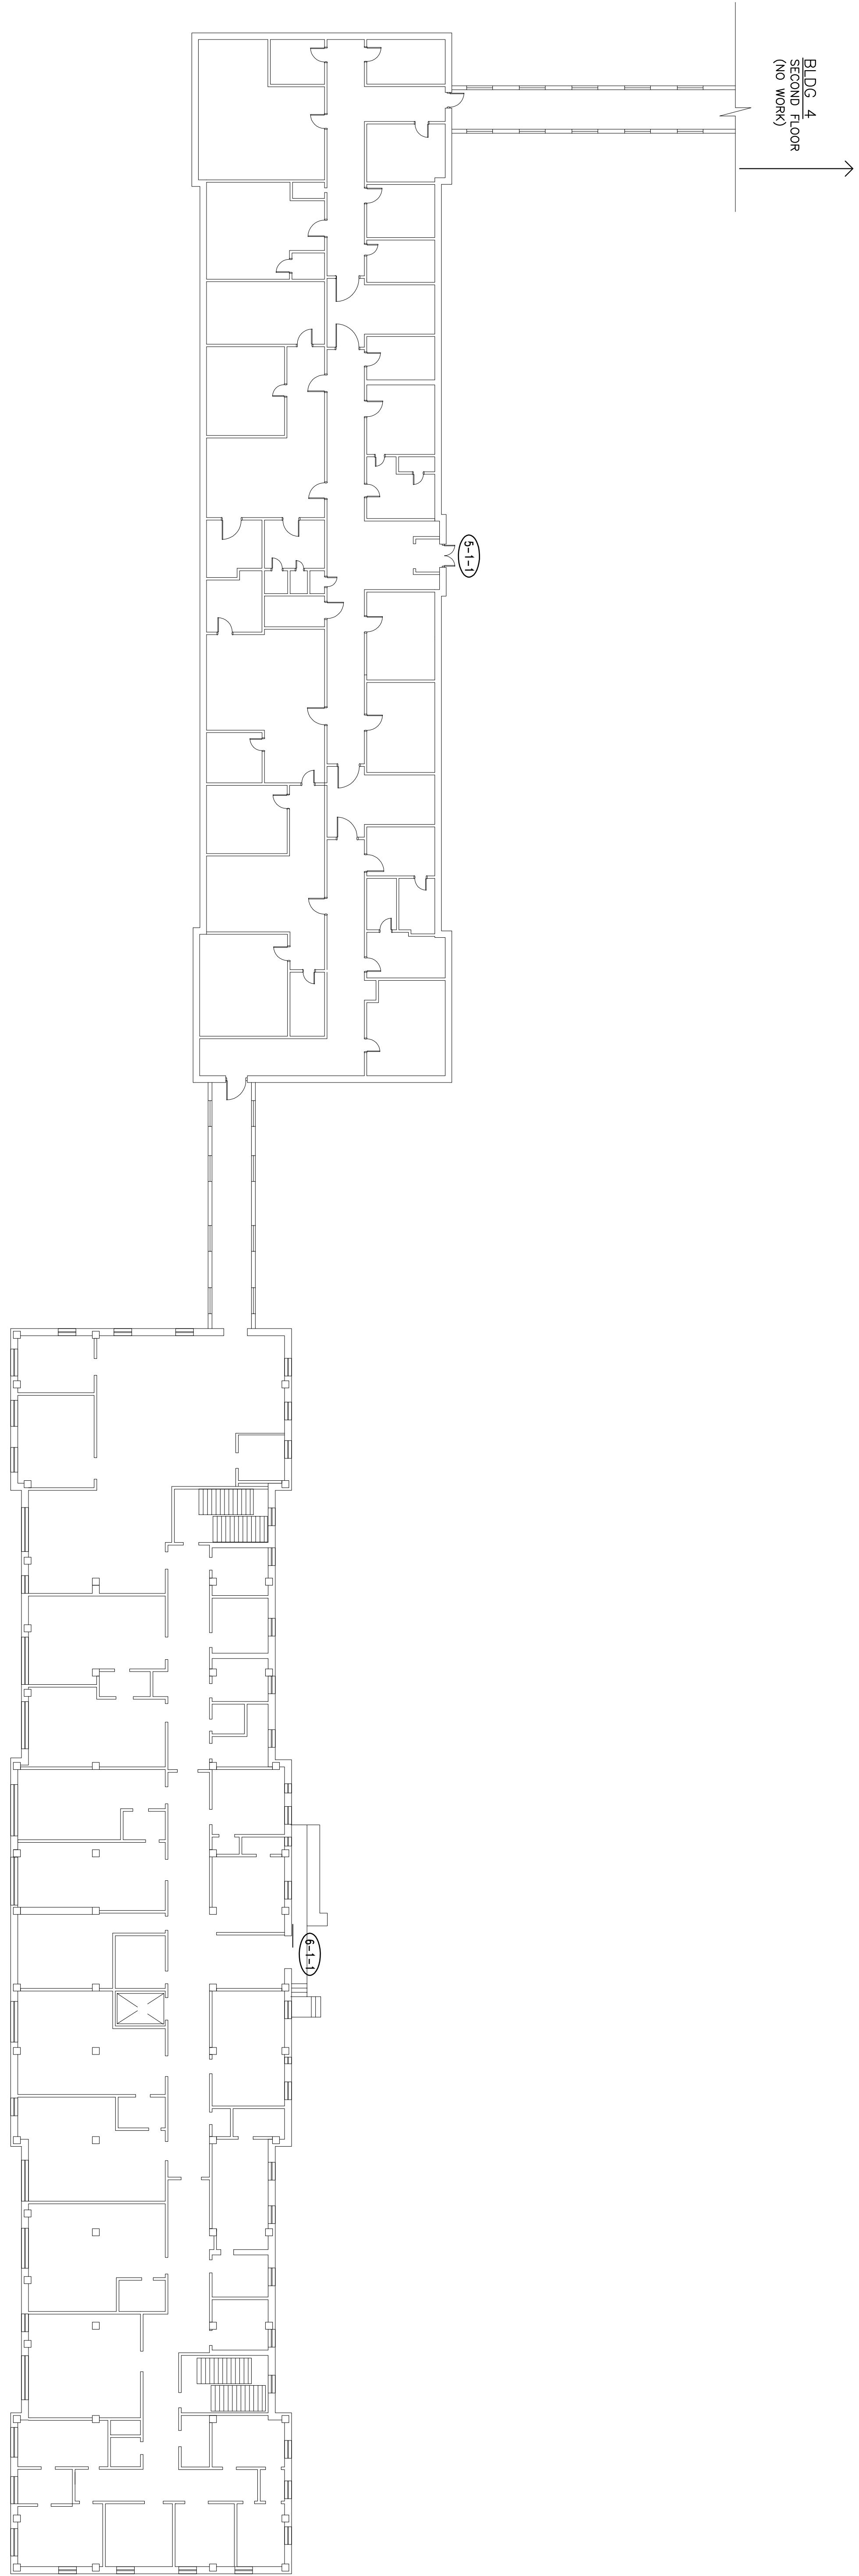

- FLOOR PLAN KEY:**

 - ▶ DRESS ALARM
 - PROVIDE 300 WIRELESS DRESS ALARM BUTTONS FOR THE ENTIRE CAMBUS - OWNER
 - INSTANT CENTRUM WIRELESS RECEIVER IN SECURITY CLOSET IN BACK BUILDING
 - INSTANT CENTRUM WIRELESS RECEIVER IN SECURITY CLOSET IN FRONT BUILDING
 - CONNECT TO SECURITY NETWORK SWITCH w/ CAT 6 CABLEING
 - ▶ ACCESS CONTROL
 - NEW ACCESS CONTROLS ON EXIST. DOOR - SEE WIRING DIAGRAM ON SHEET A111 FOR NEW HARDWARE
 - SEE WIRING DIAGRAM ON SHEET A111 FOR EXISTING CONNECTIONS
 - ▶ EXISTING
 - EXISTING ACCESS CONTROLS TO REMAIN AND DOOR CONTACT
 - INSTANT DOOR CONTACT AT DOOR FRAME
 - CONNECT DOOR CONTACT TO INPUT MODULE LOCATED IN THE SECURITY CLOSET
 - INSTANT MODULE TO DOOR ACCESS CONTROLLER
 - ▶ SECURITY CLOSET
 - INSTANT POWER SUPPLIES IN THE CLOSET FOR ACCESS CONTROLS - CONNECT TO INSTANT MERCURY BOARD ACCESS CONTROLLERS
 - CONTROLLERS PLUMB WIRELESS RECEIVER AND CONNECT TO EMERGENCY PWR SWITCH
 - INSTANT SECURITY NETWORK PWR SWITCH EXTEND AND HARDWARE DEVICES TO NEAREST 120V EMERGENCY PANELBOARD (INDICATED WITH A 1), PROVIDE 2 1P-20A SEE WIRING DIAGRAM ON A111 FOR HARDWARE CONNECTIONS
 - MOUNTED LOCKABLE NETWORK CABINET
 - ▶ EXISTING
 - INSTANT SECURITY NETWORK PWR SWITCH
 - CONNECT EXIST. ACCESS CONTROLLERS TO SECURITY NETWORK SWITCH CONTROLLER AND EXIST. POWER SUPPLY TO EMERGENCY POWER CENTRUM WIRELESS RECEIVER AND CONNECT TO EMERGENCY POWER EXTEND AND HARDWARE DEVICES TO NEAREST 120V EMERGENCY PANELBOARD (INDICATED WITH A 1), PROVIDE 2 1P-20A CIRCUIT BREAKERS
 - SEE WIRING DIAGRAM ON A111 FOR HARDWARE CONNECTIONS
 - INSTANT HARDWARE DISMISSE A WALL MOUNTED LOCKABLE NETWORK CABINET
 - ▶ CAMERAS
 - NEW
 - PELCO SPECTRA V PZ P CAMERAS
 - CONNECT CAMERAS WITH CAT 6 CABLEING BACK TO THE SECURITY NETWORK SWITCH
 - EXISTING THE SECURITY CLOSET
 - EXISTING CAMERA TO REMAIN
 - WHERE APPLICABLE REPLACE EXISTING CAMERA CLOSET TO NEAREST SECURITY CLOSET
 - CONNECT EXISTING NETWORK SWITCH IN THE SECURITY CLOSET
 - ▶ REPAIRED
 - REPLACE EXISTING CAMERA WITH PELCO
 - CONNECT CAMERA TO THE SECURITY NETWORK SWITCH IN THE SECURITY CLOSET